


PUMP INFORMATION  
MAKE \_\_\_\_\_  
MODEL \_\_\_\_\_  
HP \_\_\_\_\_

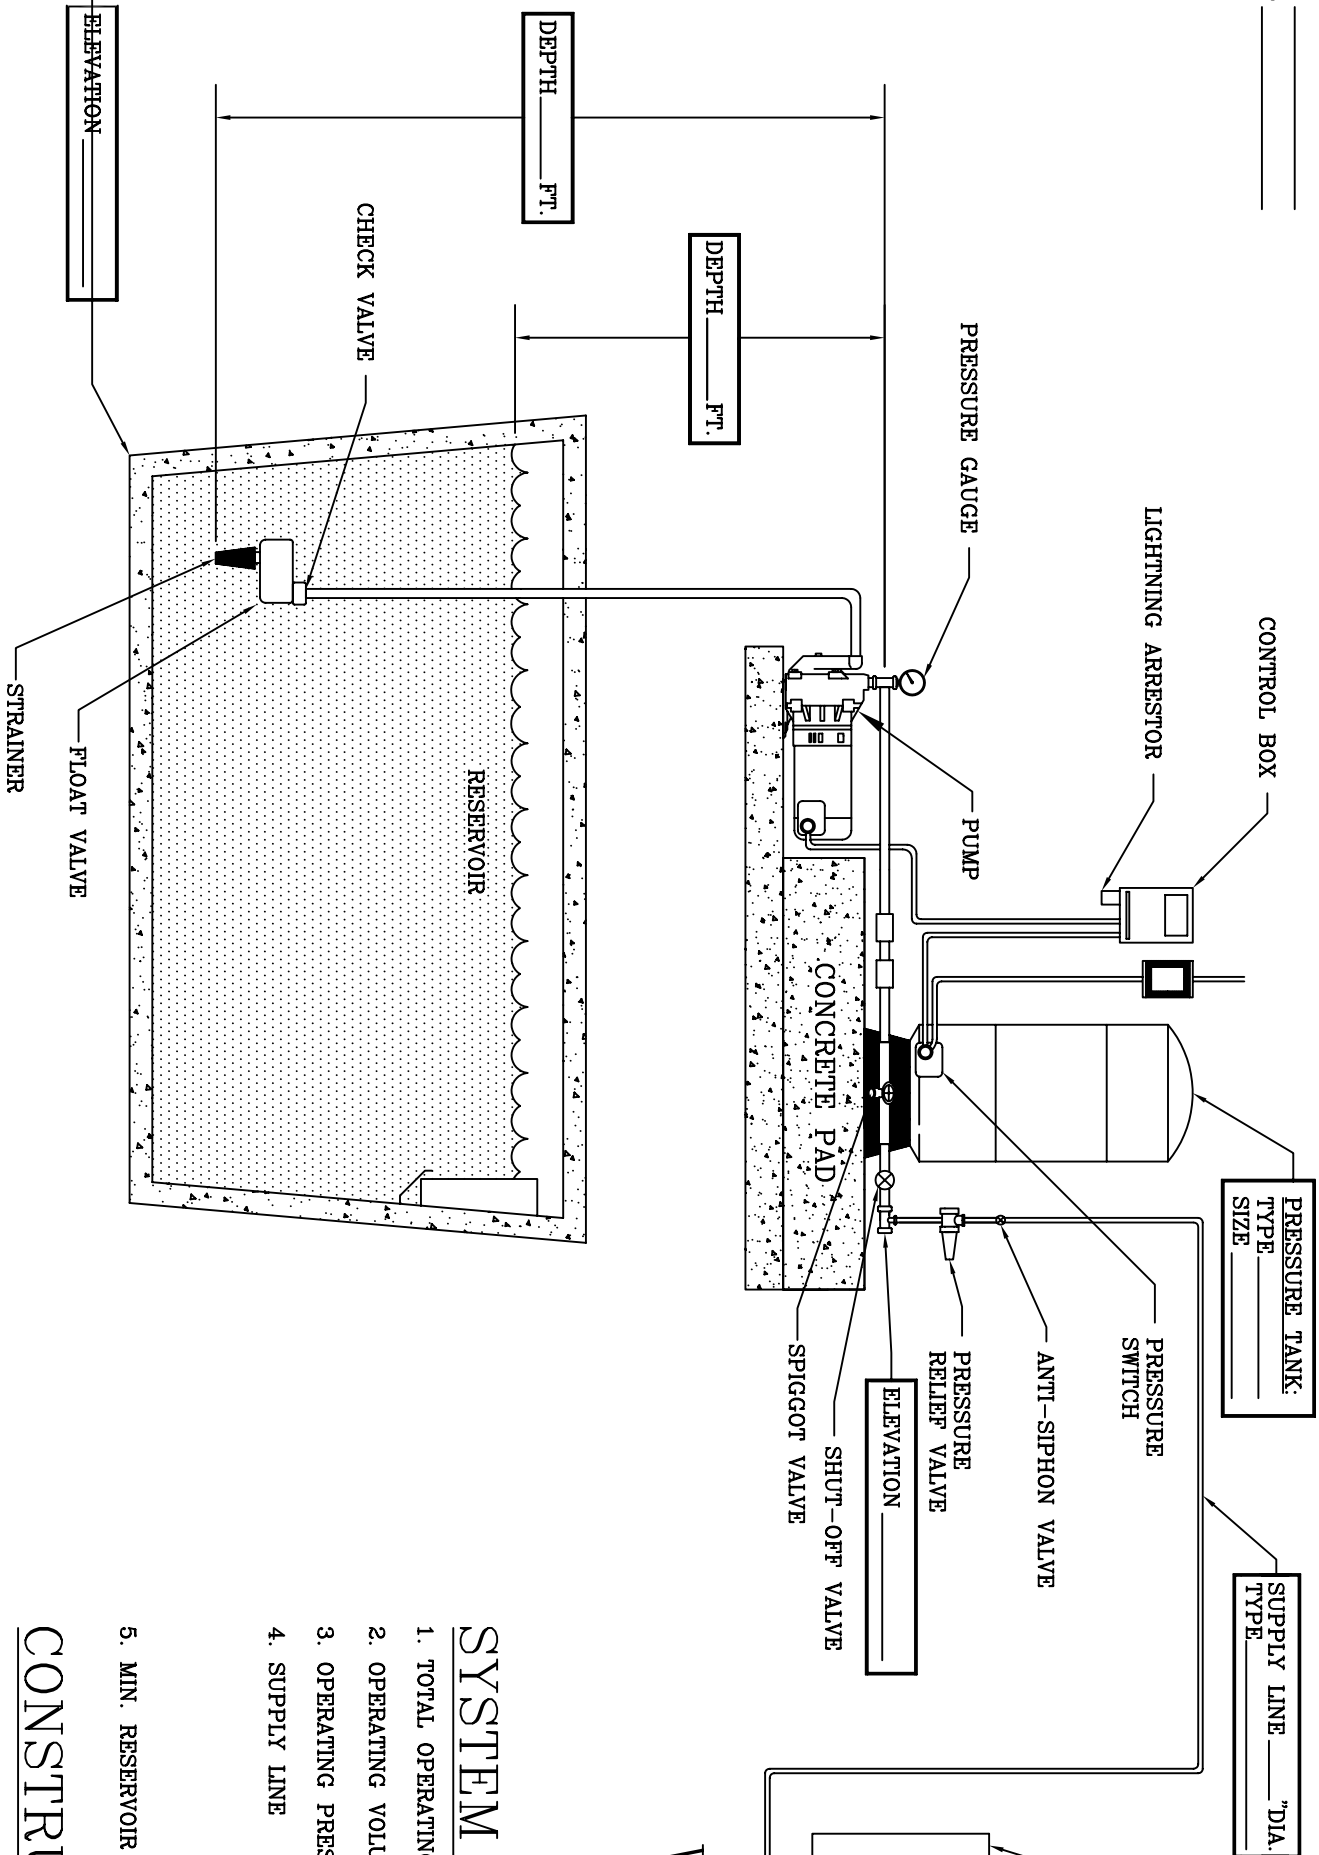

## SYSTEM DATA

- TOTAL OPERATING HEAD \_\_\_\_\_ FT.
- OPERATING VOLUME \_\_\_\_\_ GALLONS PER MINUTE
- OPERATING PRESSURE (AT PUMP) \_\_\_\_\_ PSI
- SUPPLY LINE SIZE LENGTH  
\_\_\_\_\_  
\_\_\_\_\_
- MIN. RESERVOIR SIZE \_\_\_\_\_ (REQUIRED)

## CONSTRUCTION NOTES

- SYSTEM SHOWN IS A REPRESENTATION. MODIFICATIONS OR ADDITIONS SHOULD BE MADE AS APPROVED BY NRCS REPRESENTATIVE
- ANTI-SIPHON VALVE IS REQUIRED FOR ALL SYSTEMS. ANTI-SIPHON VALVE SHALL BE A WATTS 9-D OR EQUIVALENT.

- 
- 
- 
- 
- 

Watering Facility



\_\_\_\_\_ COUNTY, PENNSYLVANIA  
**SHALLOW WELL PUMP WATERING SYSTEM**

Date \_\_\_\_\_  
Designed \_\_\_\_\_  
Drawn **TIM PETERS**  
Checked \_\_\_\_\_  
Approved by \_\_\_\_\_

File No. **PA-070.dwg**  
Drawing No. 06/05/07 13:01  
**PA-070**

Sheet \_\_\_\_\_ of \_\_\_\_\_

NOT TO SCALE